

"x" DIMENSION


2" = 6 $\frac{1}{2}$ "
 3" = 7"
 4" = 7 $\frac{1}{2}$ "
 5" = 8 $\frac{1}{2}$ "
 6" = 9"
 8" = 10 $\frac{1}{2}$ "
 10" = 12"
 12" = 13 $\frac{1}{4}$ "
 15" = 14 $\frac{3}{4}$ "

MINIMUM
ALLOWABLE
CLEARANCE

2" = 10 $\frac{13}{16}$ "
 3" = 11 $\frac{13}{16}$ "
 4" = 12 $\frac{11}{16}$ "
 5" = 14 $\frac{3}{4}$ "
 6" = 16 $\frac{1}{4}$ "
 8" = 19 $\frac{1}{8}$ "
 10" = 21 $\frac{1}{4}$ "
 12" = 24"
 15" = 26 $\frac{1}{8}$ "

HORIZONTAL
CLEARANCE

2" = 1 $\frac{1}{4}$ "
 3" = 1 $\frac{3}{4}$ "
 4" = 2 $\frac{3}{16}$ "
 5" = 2 $\frac{3}{4}$ "
 6" = 3 $\frac{3}{4}$ "
 8" = 4 $\frac{5}{8}$ "
 10" = 5 $\frac{1}{4}$ "
 12" = 6 $\frac{1}{4}$ "
 15" = 7 $\frac{7}{8}$ "

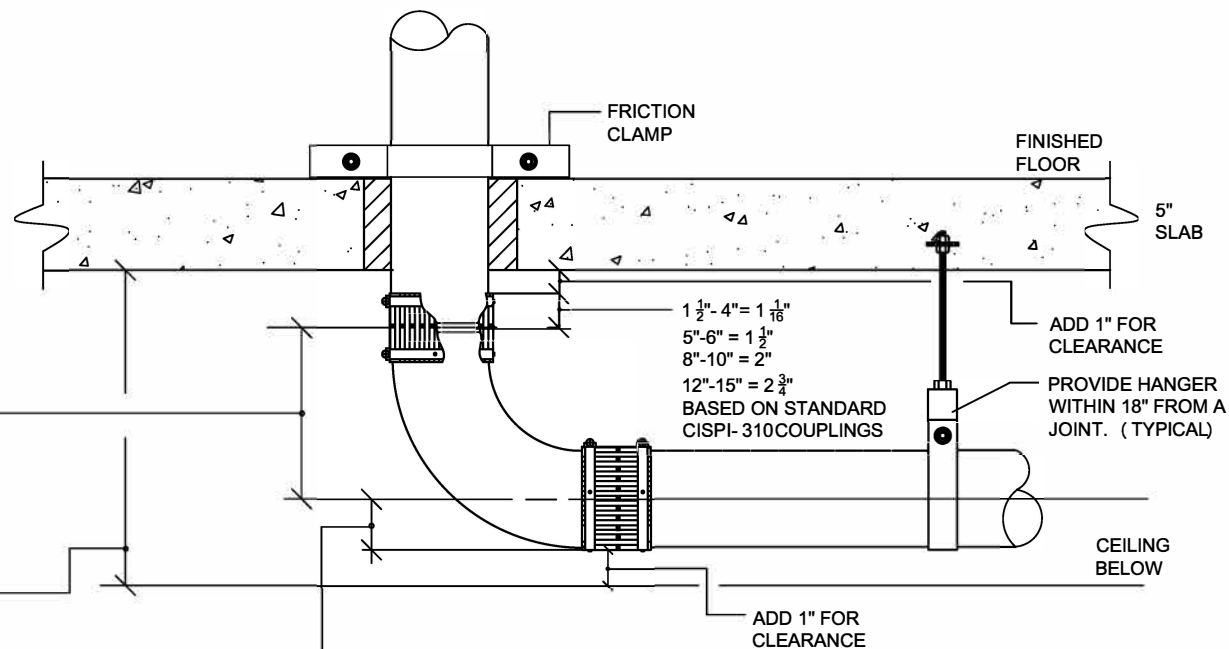

NH-16 SHORT SWEEP CLEARANCE REQUIREMENTS

NOTE:
 RESTRAINT IS REQUIRED ON ALL PIPE 5" AND
 LARGER AT ALL BRANCH TAKE-OFFS, AND
 CHANGES IN DIRECTION TO PROTECT
 AGAINST HORIZONTAL MOVEMENT AND
 JOINT SEPARATION

06/02/20

NOTICE: THE INFORMATION ON THIS PAGE PROVIDES GENERAL GUIDELINES. IT SHOULD BE USED ONLY AS A REFERENCE AND NOT AS A GUARANTEE OF PERFORMANCE. SPECIFIC INSTALLATION INSTRUCTIONS AND TECHNIQUES MAY BE REQUIRED AS A RESULT OF LOCAL PLUMBING AND BUILDING CODES, ENGINEERING SPECIFICATIONS AND INSTRUCTIONS.

CPF-1 1

START OF ELEVATION
 USING NH-16
 SHORT SWEEP

CHARLOTTE
 PIPE AND FOUNDRY COMPANY